



**ALARM LOCK**

345 Bayview Avenue

Amityville, New York 11701

For Sales and Repairs 1-800-ALA-LOCK


For Technical Service 1-800-645-9440


Publicly traded on NASDAQ Symbol: NSSC

© ALARM LOCK 2007

# QUICK START PUSH BAR MODEL 715

W11584 1/07

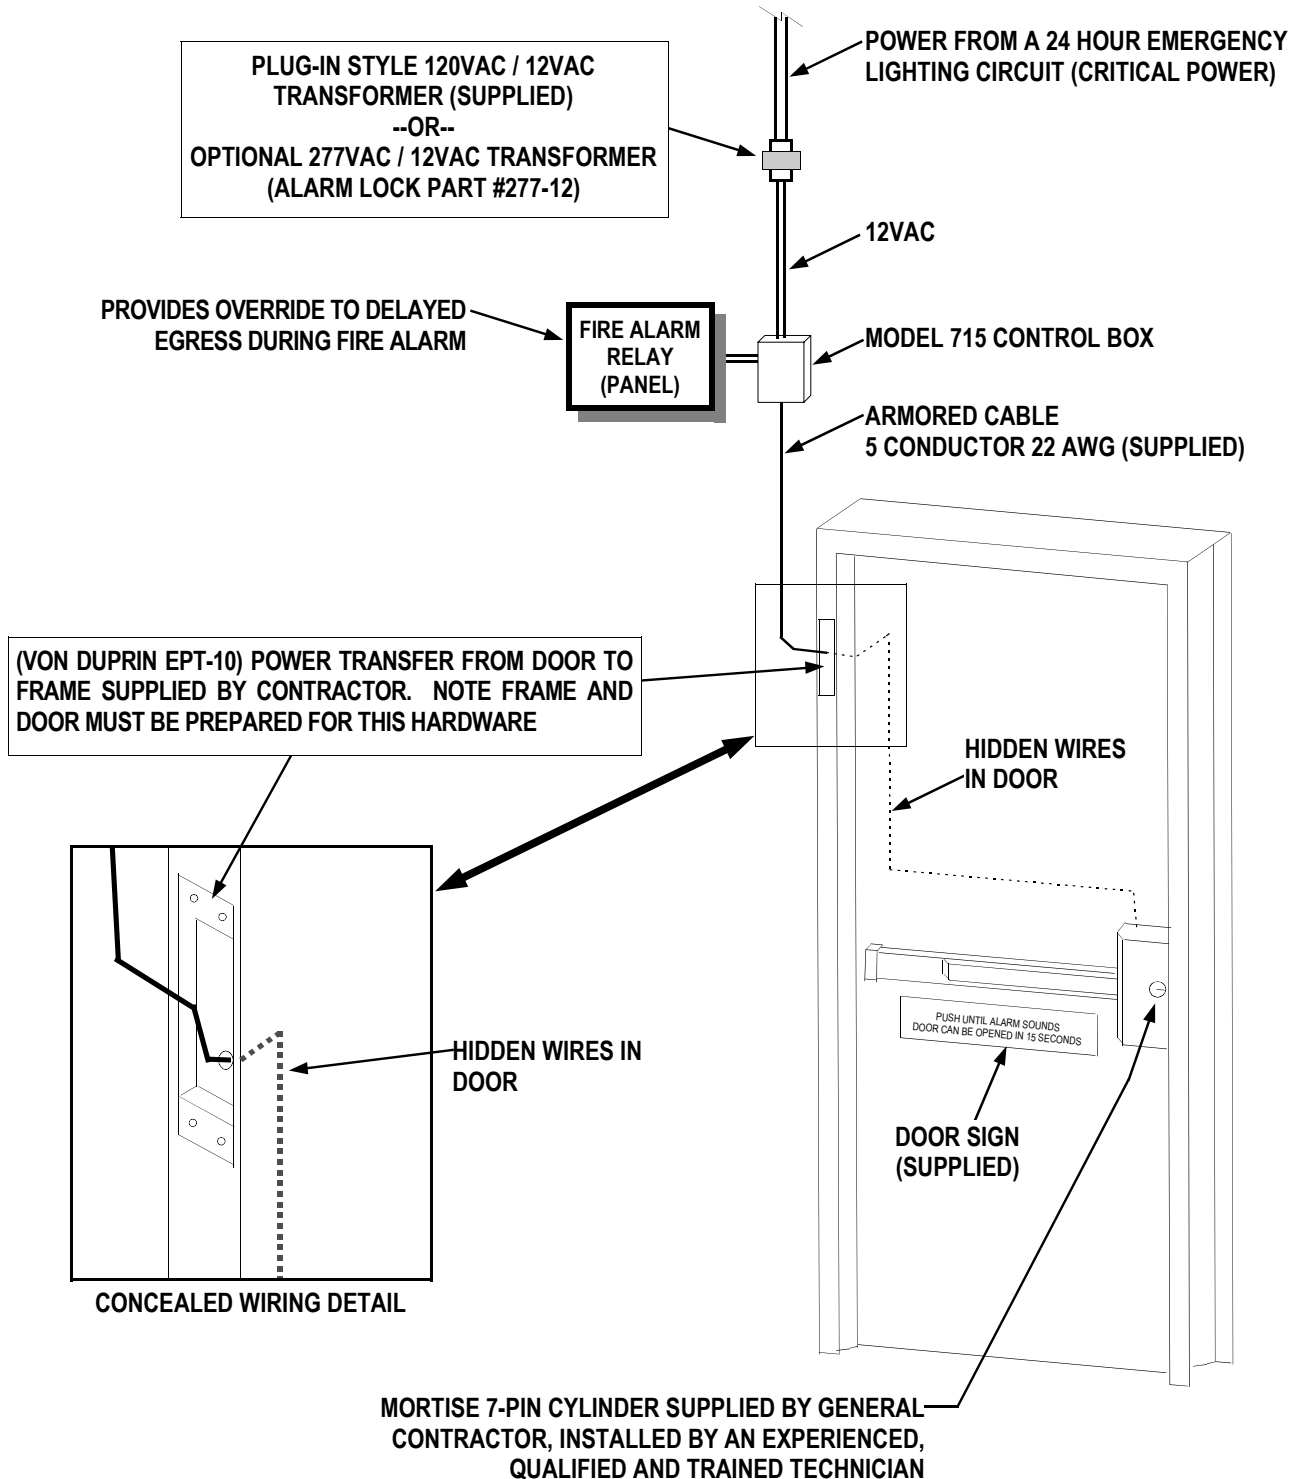

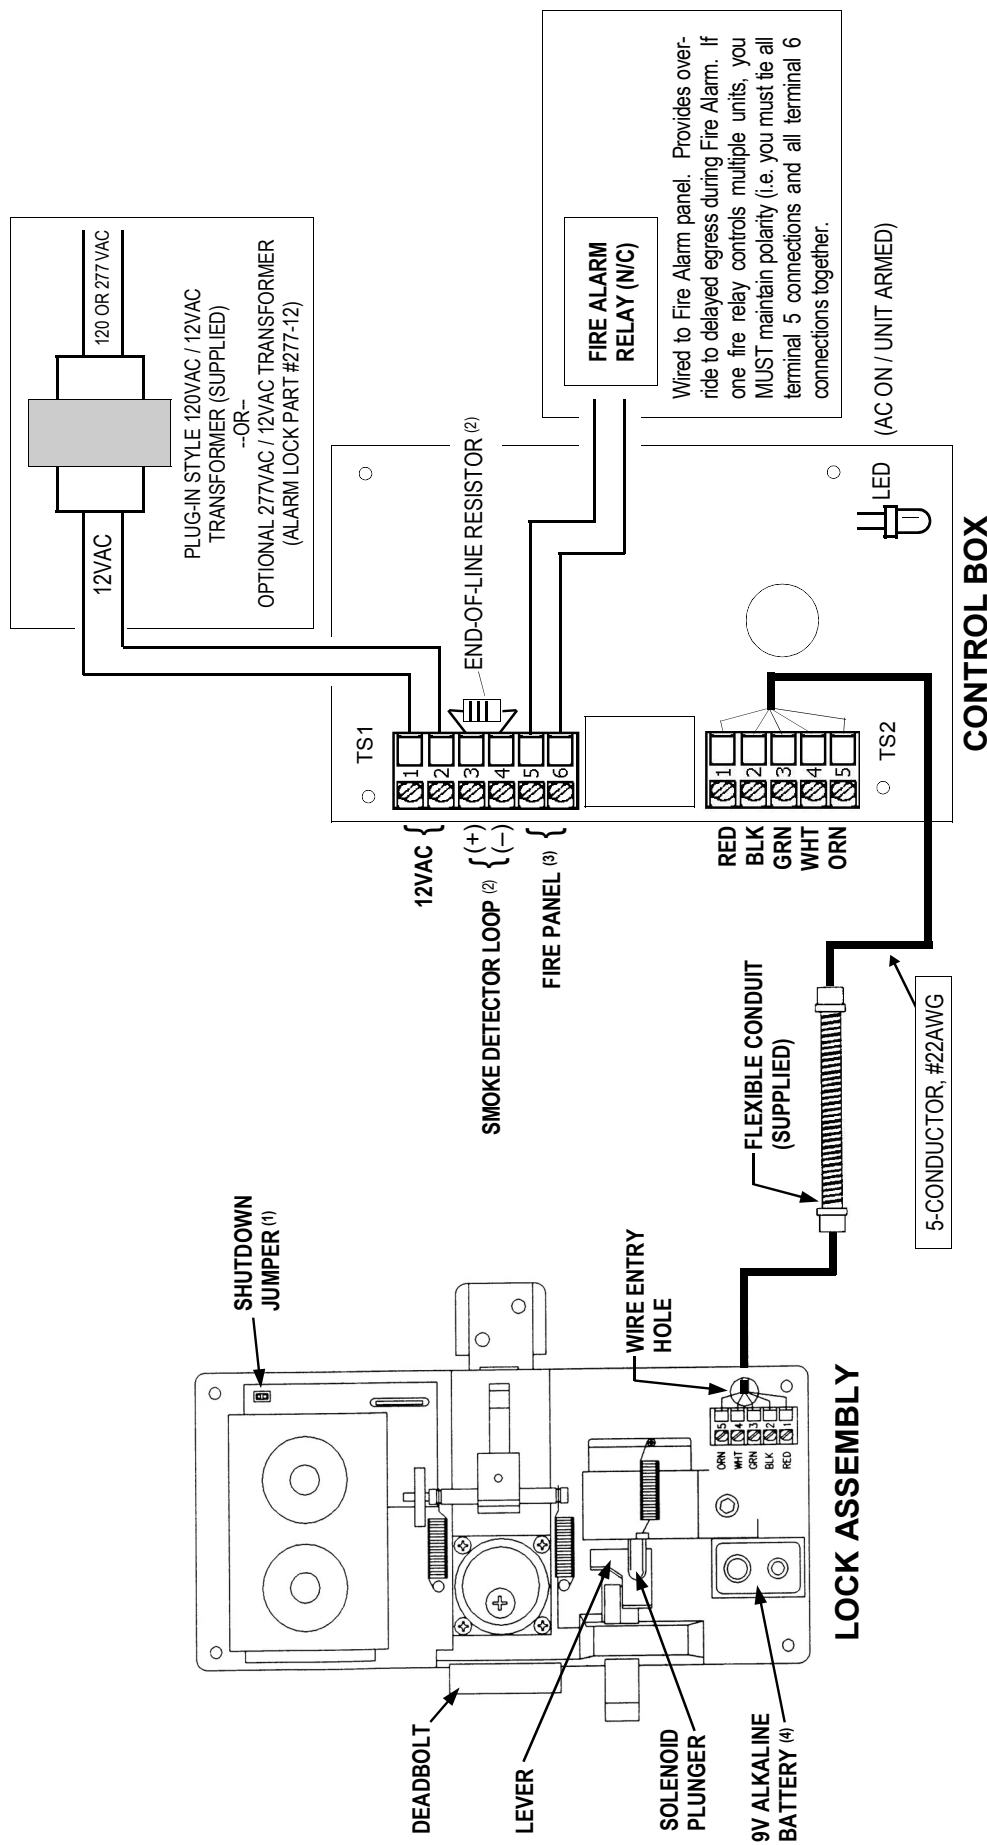

Wired and connected to panic device by electrical contractor

**NOTES:**

- (1) REMOVE JUMPER FOR TWO-MINUTE ALARM SHUTDOWN.
- (2) IF SMOKE DETECTOR IS USED, REMOVE END-OF-LINE RESISTOR AND INSTALL ACROSS SMOKE-DETECTOR TERMINALS.
- (3) REMOVE JUMPER IF CONNECTING TO FIRE PANEL OR REMOTE NORMALLY-CLOSED KEYSWITCH.
- (4) BATTERY MUST BE INSTALLED, HOWEVER DO NOT CONNECT BATTERY UNTIL AC POWER IS APPLIED.